

A IMPORTANT INSTRUCTIONS

For Installation 441V WEDGE: SURFACE MOUNT ONLY

Warning: The Luminaire should only be used complete with its protective shield (cover)

Lumascope Lighting Industries Pty Ltd
38-44 Enterprise Street, Cleveland, QLD 4163, Australia
PO Box 1875, Cleveland D.C., QLD 4163, Australia
T 07 3286 2299
F 07 3286 6599
E sales@lumascope.com.au
W www.lumascope.com.au

Note: To achieve IP65 rating mount with point UP, use round cable (size 5-10mm) to suit entry gland supplied with fixture.

1 Please exercise caution when placing fixture.
Place above head height.

Mark locations of fixtures (refer voltage drop chart over).
Mark and drill/cast holes.

2

Remove lid from fixture and insert cable gland and o-ring into base (optional, required for IP65 rating).

3

Terminate **Active (Line)**, **Neutral** and **Earth** supply cable in fixture and tighten cable gland onto cable.
Note: Ensure only round supply cable is used and cable gland seals on the outer insulation.

4

Screw base to mounting surface.

5

Insert lamp.

6

Test Fixture/ Fixtures

7

Re-Attach Lid to fixture.

LID REMOVAL




RELAMPING
Remove cover and re-lamp as per instructions 5,6,7.

LENS REMOVAL & REPLACEMENT



LUMASCAPE

MODELS LS441V
 240V 35watt max GU10.
 IP65 rated

90° N563


B IMPORTANT INSTRUCTIONS

For Installation 441V WEDGE: SURFACE MOUNT ONLY

Warning: The Luminaire should only be used complete with its protective shield (cover)

Lumascap Lighting Industries Pty Ltd
 38-44 Enterprise Street, Cleveland, QLD 4163, Australia
 PO Box 1875, Cleveland D.C., QLD 4163, Australia
 T 07 3286 2299
 F 07 3286 6599
 E sales@lumascap.com.au
 W www.lumascap.com.au

Mounting Template, 1:1

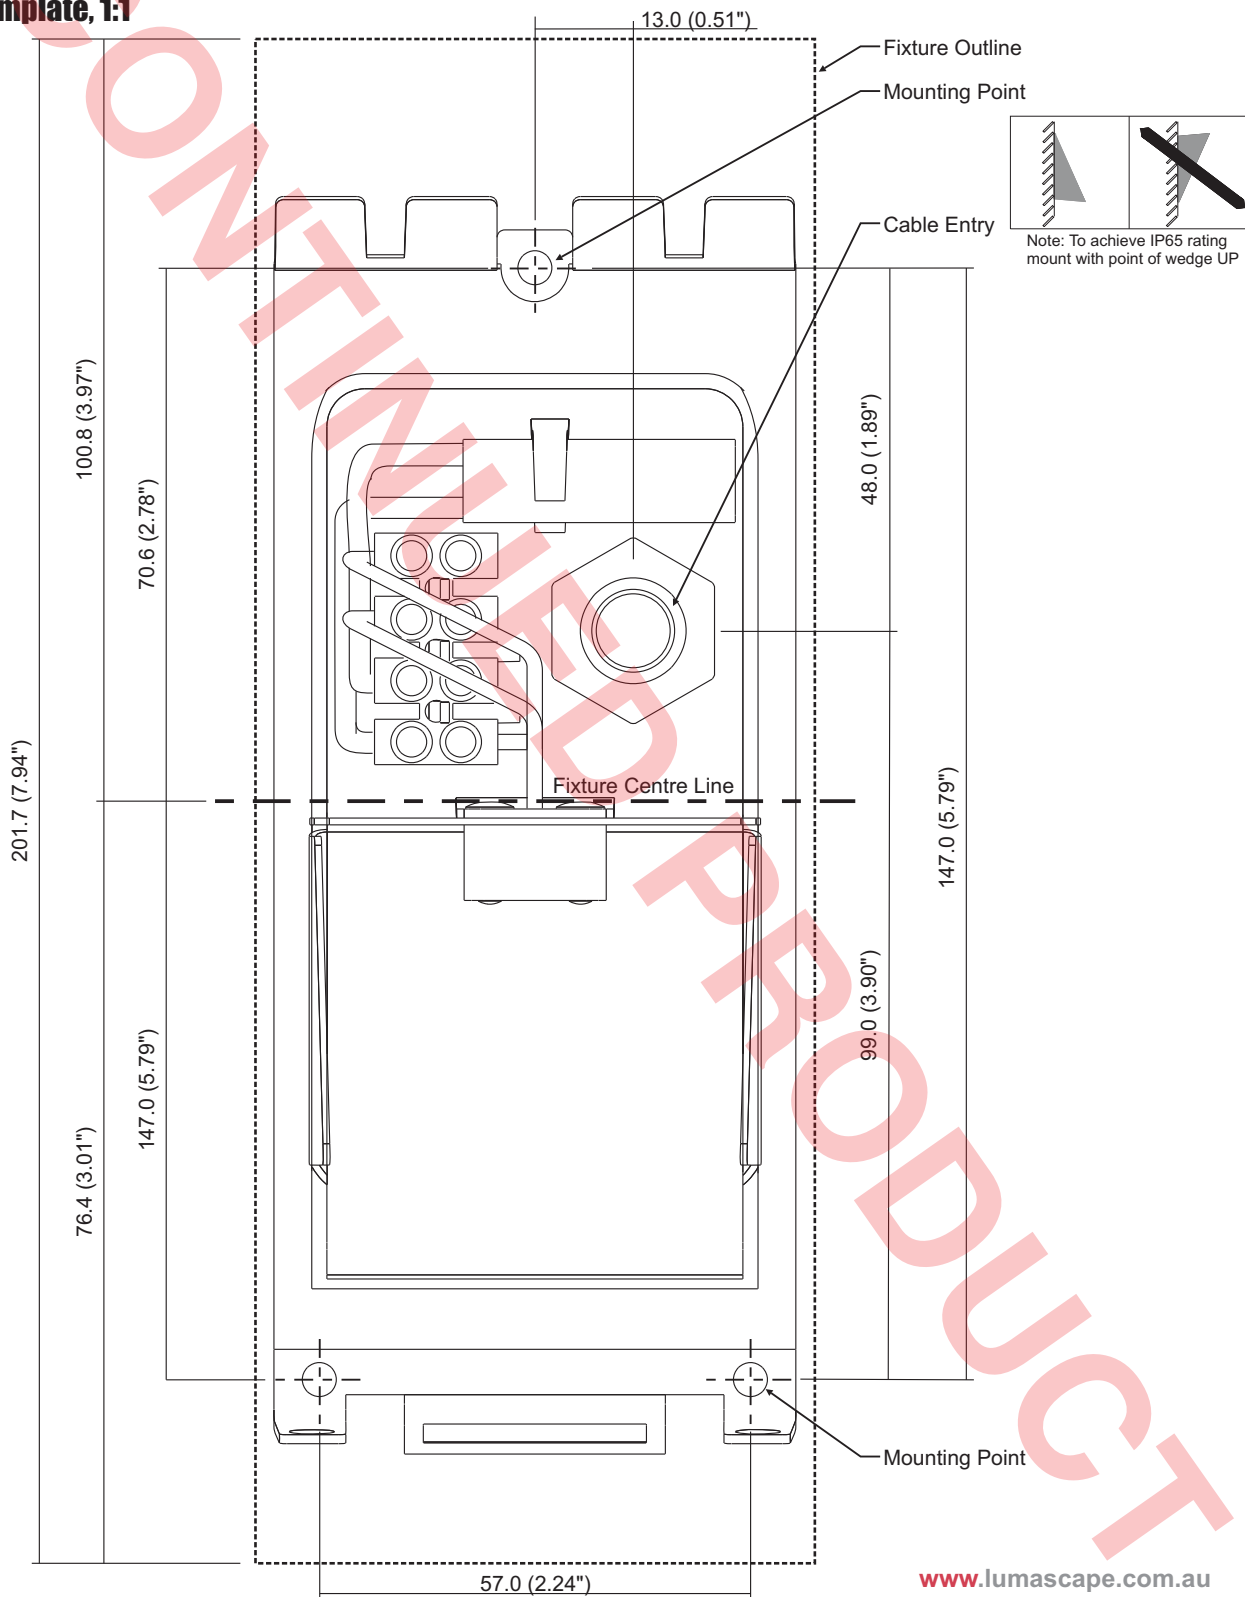

www.lumascap.com.au